



Risk of Residual Aluminum in Treated Waters with Aluminum Sulphate

Bachir Meghzili^{1,2*}, Brakchi Souad³ and Azzouz Abdelkrim³

¹Laboratoire LRPCSI, Université de Skikda, Algérie.

²Faculté des Sciences de L'ingénieur, Université Mohamed Khider, Biskra, Algérie.

³Laboratoire OPAZS, Département des Sciences Agronomiques, Université de Skikda, Algérie.

Authors' contributions

This work was carried out in collaboration between all authors. Author BM designed the study, wrote and directed the protocol, and wrote the first draft of the manuscript. Author BS performed the spectroscopy analysis. Author AA was responsible for the literature search. All authors read and approved the final manuscript.

Article Information

DOI: 10.9734/AIR/2016/24059

Editor(s):

(1) Francisco Marquez-Linares, Full Professor of Chemistry, Nanomaterials Research Group, School of Science and Technology, University of Turabo, USA.

Reviewers:

(1) Randa M. Osman, National Research Centre, Egypt.

(2) Prakash M. Munnoli, S D M College of Engineering and Technology, India.
Complete Peer review History: <http://sciencedomain.org/review-history/13601>

Original Research Article

Received 1st January 2016
Accepted 24th February 2016
Published 9th March 2016

ABSTRACT

Waters treatment by aluminum sulphate is the most used process in waters treatment to remove unwanted microorganisms. The inorganic coagulants are partially hydrolyzed salts; their dissolution in water depends mainly on this one's pH. However, aluminum residues may remain after dissolving. In this study, determination of residual aluminum in treated waters is performed by the standard addition method. Treated waters from the treatment station in Skikda's city contained 210 g / L of residual aluminum for an average dose equal to 40 m /L of aluminum sulphate. The residual aluminum in treated water exceeds WHO standards (200 µg / L), and far from the recommended standards of 100 g / L in all searches. Trials were made with laboratory flocculators under the same conditions. The residual aluminium obtained by the same method, is 182 mg / L, giving 13.33% less than the WHO standards. Another trial was carried out with a dose of 40 mg / L alum. As adjuvant, a bentonite from M'Zila (Algeria) was used with a dose of 3 mg / L. This test helped to reduce the amount of residual aluminum in raw water (20.48%, lower than the recommended standards).

*Corresponding author: E-mail: meghzili_bachir@yahoo.fr;

In order to investigate the causes of these excess, trials were made with the laboratory flocculators under the same conditions in that station. The residual aluminum obtained by the same standard addition method, is 182 mg / L (giving 13.33% less than the WHO standards). The dry residues were characterized by analysis using a scanning electron microscopy (SEM) and EDX (MEB-EDX) to show the different spectra of the aluminum in the dry residue. The crude bentonite is characterized by the elemental chemical method using X-ray fluorescence.

Keywords: Aluminum sulphate; bentonite; residual aluminium; MEB-EDX; fluorescence X.

1. INTRODUCTION

The residual aluminum present in water that has been treated clarification with aluminum sulphate may be the result of an overdose or no conditions favourable to its hydrolysis (pH and temperature). The Flocculants bind to particles in suspension and cause them to precipitate as sludge at the bottom of flocculators and decanters. If the conditions are not met, some of the aluminum remains in solution [1].

Epidemiological studies have shown the dangers of aluminum and some countries have already taken their precautions. Canada, for example, tolerates less than 100 µg / L in the treated water [2]. In France, epidemiology research team of Professor Jean François Dartigues, University of Bordeaux has published several articles in the American Journal of epidemiology [3-5] treating the relation between aluminium and Alzheimer's disease. A lot of works advocate a tolerable threshold limited to 100 µg / L in drinking water, while remaining vigilant about monitoring the waters treatment plants. The inorganic monomeric aluminum represents their main fraction of aluminum after water treatment (62% of total).

A study performed in Europe estimated that the intake of aluminum from drinking water is less than 5% of daily intake from other sources like food, utensils, medicines etc. [6].

An estimated total daily average intake of 8.26 mg or the share contributed by the water is less than 0.4 mg of aluminum.

Higher concentrations are found in drinking water in relation to the quality of raw water over-loaded if the pH is not controlled properly during the steps of treatment and optimizing the dose in steps of coagulation, decantation and filtration [7,8]. In distribution networks, the process of disinfection can be limited if we find high levels of residual aluminum that retains and protects

microorganisms (American Water Works [8,9]. The best results are obtained with a pH between 6 and 7, minimum solubility range of aluminum hydroxide during coagulation [10].

The chemistry of aluminum in water can be described by several forms [11-13].

- five monomers: Al^{3+} , $Al(OH)^{2+}$, $Al(OH)_2^+$, $Al(OH)_3^0$, $Al(OH)_4^-$
- three polymers: $[Al_2(OH)_2]^{4+}$, $[Al_3(OH)_4]^{5+}$, $[Al_{13}O_4(OH)_{24}(H_2O)_{12}]^{7+}$
- One precipitate: $Al(OH)_3$

Aluminum mononuclear hydrolytic products are combined to form polynuclear species in solution [3]. Aluminum begins to polymerize when the pH of an acidic solution substantially increases beyond 4.5. [14].



Polymerization produces gradually larger structures and eventually lead to the formation of the Al_{13} polycation [15,16].

According to Jones and BENOIT [17], the aluminium present in the treated water is largely located in dissolved forms. The dissolved aluminum is defined as aluminum that passes through a 0.22 µm filter [7].

In highly charged water, it is important to control the total aluminum content by optimizing coagulation and filtration processes. We must control the dosage of the coagulant and coagulation pH, because it must be accompanied by good stirring allowing good flocculation of suspended solids and will facilitate their decantation before the step of filtration.

If any one of these steps is neglected, it may cause an increase of residual aluminum. The pH is one of the main factors that determine the form of aluminum present in water; solubility of aluminum increases in lower pH [9].

2. MATERIALS AND METHODS

2.1 Operating Procedure

Analytical results of the raw water and the treated water in station are shown in Table 1.

2.2 Determination of the Content of Aluminum in the Treated Water

2.2.1 Principle

The aluminum with cyanine Erichrome R forms a red complex at pH 6. After 5 minutes, the analysis is performed at the wavelength of 535 nanometers. The method used is the standard addition method.

Equipment

- UV/visible type Shimadzu UV-1605.

Reagents

- Solution Erichrome cyanine R
- Acetic acid buffer solution pH 6
- Ascorbic Acid
- Solution 0.1 Mole EDTA (Éthylène Diamine Tétra-Acétique)
- Sulphuric acid 0.05 Mole
- Al Solution 0.1 g / L

2.2.2 Procedure

Water sample is adjusted to pH of 3-3.5. then, 10 ml of sample are put in 100 mL flasks. In the first flask was added all reagents except the aluminum standard solution (to adjust the zero of spectrophotometer). In other vials, we put all reagents except EDTA and we add an increasing dose of standard aluminum. The absorbance of the solution of each flask was then measured and traced in curve $A = f(C)$, the absorbance versus concentration aluminum and from this curve, the amount of aluminum was determined in the sample.

2.2.3 Description of tests jar-test

Jar test is carried out according to the procedures outlined in paragraph 1.2.

The tests were conducted in a laboratory flocculator comprising six agitators and six 500 mL beakers. The water to be treated is placed in each beaker. The rapid stirring is

carried out at 200 rev / min; at time zero, we add increasing doses of aluminum sulphate in each of the beakers. The phase rapid stirring lasts three minutes. The rapid stirring is followed by 17 minutes of slow stirring at 45 rev / min. After decanting for 30 minutes, we take a quantity of supernatant to analyze residual aluminum. The optimum dose of aluminum sulphate is 40 mg / L (determined by jar-test). The results of quality parameters analysis are presented in Table 2.

In Table 2, we have considered only the monitoring of the residual aluminum in the jar-tests and the water treated in station, then to the same dose was added a dose of 3 mg / L of bentonite as an adjuvant. At the end, the results will be compared between them.

2.3 Analysis of Solid Materials

2.3.1 Characterization bentonite

Bentonite is characterized by the National Entreprise of Non-Ferrous Mining and Useful Products (ENOF) in 2007.

2.3.2 Electronic scanning microscopy (EMF)

This operation allows to visualize the morphology (shape, size) of particles and their possible surface roughness (image 1, 2 and 3) directly. It consists to scan, line by line, the surface of the particles by an incident beam of high energy electrons, thereby causing the emission of secondary electrons of low energy. These are sent to a detector which transmits the signal to a screen of where the scanning is synchronized with the scanning of the sample. The contrast of the image reflects the relief of the sample. These secondary electrons allow reconstruction of a magnified picture of the surface.

In laboratory, images of the scanning electron microscopy (SEM) were performed using a Philips XL 30 microscopy equipped with a field emission gun. The sample is prepared by depositing the powder on the aluminum support coated with a thin layer of graphite whose surface is adhesive. It is then vacuum metalized, by sputtering a layer of gold having a thickness between 10 and 20 nm.

2.3.3 MEB-EDX dry residues

Figs. 4, 5, 6 shows the various spectra of the minerals present in different samples. The peaks of aluminum vary from one sample to another.

The higher amounts of aluminum are located on the sample 3 and then the second and the lowest peak on the sample 1. Fig. 3 shows a larger concentration of aluminum on the image 3.

Table 1. Physic-chemical analysis of water supply (Central Laboratory of the company's petrochemical industries, ENIP)

Parameters	Units	Raw water	Treated water station
Aspect	-	Disorder	Limpid
pH	-	8.10	7.78
Conductivity	µs/ cm	418	425
Salinity rate	mg/L	360	340
Suspended materials	mg/L	42	Traces
Chlorides	mg/L	78.55	72.73
Carbonates	mg/L	Traces	Traces
Bicarbonates	mg/L	132.41	127.32
Calcium	mg/L	50.79	50.79
Magnesium	mg/L	14.40	14.40
Total hardness	°F	18.6	18.6
Sulphates	mg/L	46.23	44.20
Phosphates	mg/L	Trace	Traces
Potassium	mg/L	4.9	4.9
Sodium	mg/L	9.3	8.3
Dissolved organic carbon	mg/L	38.02	1.68
Ammonium	mg/L	0.42	Traces
Nitrites	mg/L	Trace	Traces
Nitrates	mg/L	Traces	Traces
Total iron	mg/L	1.91	1.88
Cuivre	mg/L	0.37	0.36
Mercury	µg/L	3.80	0.76
Aluminum	µg/L	-	210.00
Turbidity	NTU	8.87	2.96
Organic matter content	Mg O ₂ /L	8.70	5.55

Table 2. Results of analyzes of quality parameters

Parameters	Raw water	(jar-test) Aluminum sulphate	Treated water station (sulphate Al)	Aluminum sulphate +Bentonite
Doses (mg/L)	-	40	40	40 +3
Temperature (°C)	28	29,5	28	29
Conductivity (µs/cm)	545	538	559	576
pH	8,10	7,32	7,61	7,79
Salinity	0,3	00	00	-
Turbidity(NTU)	4,47	1,04	2,10	3,37
Organic matter(mgO ₂ /L)	11,2	4,12	4,34	1,97
TH °F	21,00	20,40	26,20	-
TAC °F	11,50	9,70	8,10	-
% elimination turbidity	0	76,73	53,00	24,25
% élimination organic matter	0	63,21	61,25	42,41
Residual Aluminum (µg/L)	No detected	0,182	0,210	0,167

Table 3. Physico-chemical characteristics of the bentonite

Specific surface m ² /g	pH	Specific mass g/cm ³	Exchange capacity (Meq/100g)	Exchangeable cations (meq/100 g)			Na/ca
				Ca ²⁺	Na ²⁺	Mg ²⁺	
65,00	9,00	2,71	75,8	43,60	25,20	4,80	0,58

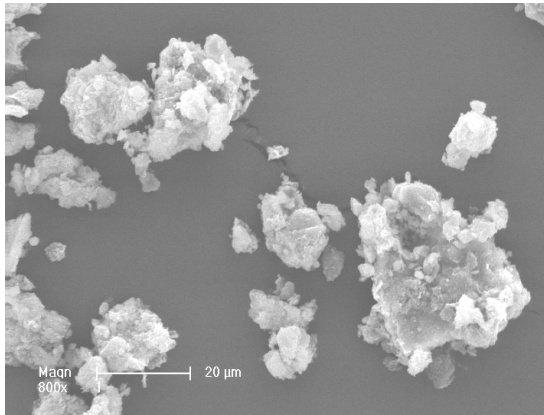


Fig. 1. Image the morphology raw bentonite particles

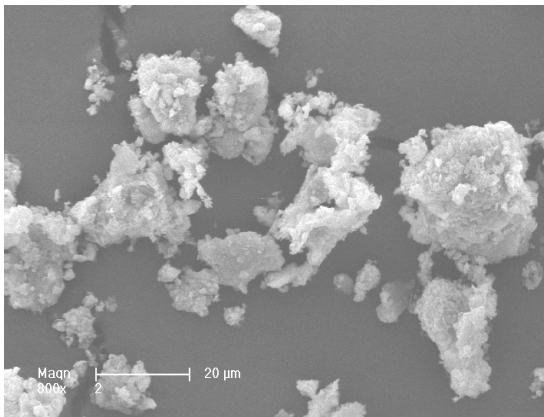


Fig. 2. Sample image with a dose of aluminum sulfate 40 mg / L

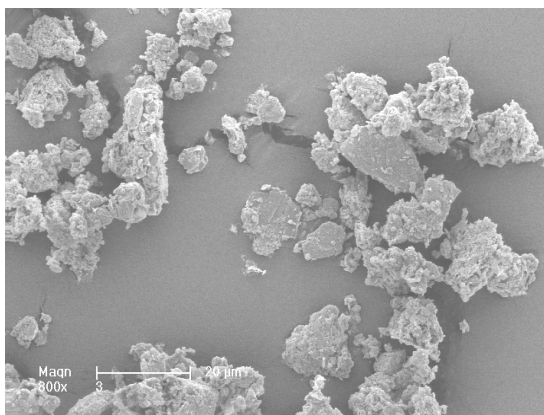


Fig. 3. Sample image with a dose of aluminum sulfate 40 mg / L + 3 mg of bentonite

2.3.4 Fluorescence (XRF)

Fluorescence spectrometry is an elemental analysis method using the physical property of

the material to determine pure elements concentrations. The X-ray spectrum emitted by the material is characteristic of the sample composition. The spectrum analysis allows deducing the elemental composition of the mass concentrations. The powder to be analyzed is put into a cup, and then pressed onto a pellet of boric acid. The device used is a fluorescence spectrophotometer X MagiX Panalytical.

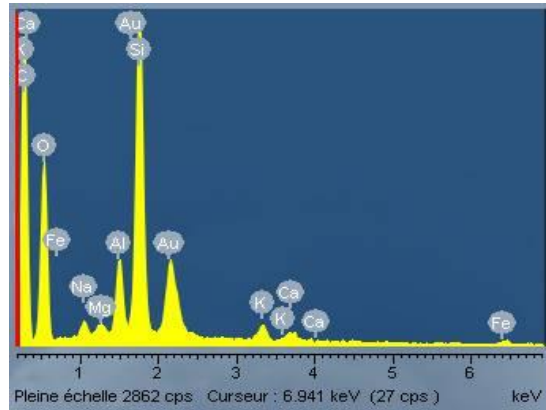


Fig. 4. Raw bentonite

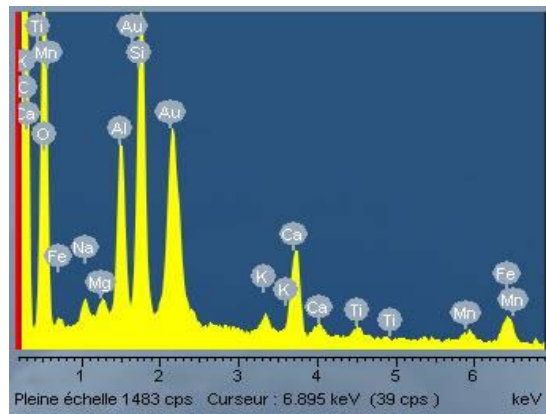


Fig. 5. Dose of aluminum sulphate 40 mg / L

3. DISCUSSION OF RESULTS

We considered only the monitoring of residual aluminium.

The 40 mg dose of aluminum sulphate / L gives 3.64 mg / L of aluminum. Station treated water contains 5.77% of the total aluminum and thus constitutes the residual aluminum. The pH of raw water arriving at the station has a value of 8.10, less favorable for the polymerization leading to the formation of the Al₁₃ polycation. After treatment the pH does not exceed 7.61 and the

minimum solubility range of aluminum hydroxide during coagulation is at a pH between 6-7 for best yields [10].

Aluminum sulfate, in addition to its action on the reduction of suspended solids, it intervenes on lowering the pH. A pH of 7.61 obtained after treatment with aluminum sulfate confirmed that there was no optimization of the various steps of clarification (dose, pH, residence time, stirring etc.).

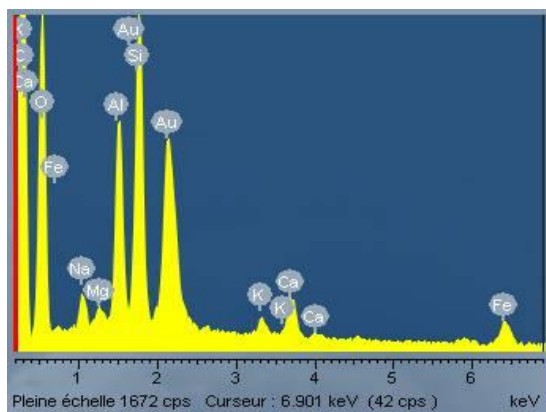


Fig. 6. Dose of aluminum sulphate 40 mg + 3 mg bentonite

For the jar-test performed with SA of 40 mg / L, 5% of the total aluminum remains in solution,

limit advised and recommended in all works on the residual aluminum in drinking water treatment.

The jar-test performed with 40 mg / L SA and 3 mg / L of bentonite, residual aluminum is 4.58% of the total aluminum, well below the 5% recommended.

According to Sollars et al. [6], in a study of aluminum in drinking water in Europe have also shown that the aluminum contribution of drinking water is less than 5%. The optimum dose determined by jar-test has eliminated 95% of the total aluminum after filtration.

Incidentally, during the process of agglomeration or coagulation, much of aluminum contained in the aluminum salts added is hydrolyzed to produce the aluminum hydroxide which precipitates and becomes part of the floc. This aluminum is therefore part of the sludge generated by the treatment process. It is possible that a small amount of added aluminum remains in the treated water, whether in colloidal particle form (Al (OH) 3) or in soluble form (Al (OH) 2+, Al (OH) 4-), according to the conditions of processing. A fault in the spillway of the sludge, incorrect scraping, unsettled flow of the sludge pumps, can cause release of the aluminum contained in the sludge and thus constitute a further addition to the existed aluminum residual.

Table 4. Mineralogical characteristics of bentonite

Montmorillonite	Quartz	Carbonates	Feldspars	Biotites
45 à 60%	15 à 20%	8 à 10%	3 à 5%	8 à 10%

Table 5. Quantification of raw bentonite sample

Analyte	Compound of formula	Concentration %	Méthod of calculating
Na	Na ₂ O	2.796	Calculated
Mg	MgO	2.913	Calculated
Al	Al ₂ O ₃	14.031	Calculated
Si	SiO ₂	69.665	Calculated
P	P ₂ O ₅	0.082	Calculated
S	SO ₃	0.491	Calculated
K	K ₂ O	2.407	Calculated
Ca	CaO	4.098	Calculated
Ti	TiO ₂	0.350	Calculated
Mn	MnO ₂	0.168	Calculated
Fe	Fe ₂ O ₃	2.879	Calculated
Rb	Rb ₂ O	0.009	Calculated
Sr	SrO	0.041	Calculated
Cl	Cl	0.069	Calculated

Table 6. Percentage of mass concentrations

Element	Concentration %	Element	Concentration %
O	48.60	K	2.00
Na	2.07	Ca	2.93
Mg	1.76	Ti	0.210
Al	7.43	Mn	0.106
Si	32.6	Fe	2.01
P	0.0359	Rb	0.00844
S	0.197	Sr	0.0347
Cl	0.0690		

Table 7. Monitoring the residual aluminum in the different samples

	Réactifs	Dose (mg/L)	Al residual	% Al residual/total Al
Water treatment station	Alumina sulphate	40	0,210	5,77%
Jar-test	Alumina sulphate	40	0,182	5,00%
Jar-test	Alumina sulphate Bentonite +	40 3	0,167	4,58%

By studying the scanning electron microscopy images and spectra in the jar-tests 1, 2, we find that the aluminum peaks are important in the second test. For a dose of 40 mg / L of SA, 5% of the total aluminum is residual; the remainder is with the settled particles. In station, and under the same conditions, the residual aluminum is 5.77% of the total aluminum. In the resort, this is explained by the non homogeneity of treatment (agitation, dosage, residence time) because it must meet the urgent need of drinking water because its capabilities are no longer sufficient to satisfy a growing of population.

In addition a portion of the aluminum present in sludge may be salted out when the sludge removal is not done automatically or when the sludge discharge pumps are stopped. Bentonite, as adjuvant reduced the residual aluminum to a lower level due to its cationic exchange capacity (75.8 meq / 100 g of bentonite) and the possibilities of retention in their foliar spaces. The bentonite used contains 14.031% of Al_2O_3 compound, giving 7.43% of aluminum, which may in its turn be hydrolyzed to form other polymers, polycations Al_{13} , which promote good decantation and reduce the residual aluminum.

4. CONCLUSION

The aluminum sulfate is used as a coagulant in the treatment of surface water; generally its pH is close or greater than 8, what does not facilitate turbidity removal, because their removal also results in reduction of pathogenic

microorganisms and also reduces the formation of by-products (organic matter) before disinfection, to prevent the formation of compounds organochlorine responsible for some cancers. Disinfection can be hindered by high levels of residual aluminum. It is imperative, in the surface water treatment process, to work in optimum conditions can lead to a minimum aluminum concentration in drinking water. In loaded water, an adjuvant of the coagulation-flocculation can help to reduce the residual of aluminum, as is the case with natural bentonite. The Favorable conditions for hydrolysis of aluminum (pH, t° , agitation and water time stay) allow the formation of the Al_{13} polycation responsible for a good flocculation and reduced residual aluminum including its harmfulness described in several studies. The tests have shown that if one respects the conditions of hydrolysis of aluminum (Table 2), we achieve an acceptable level of residual aluminum.

COMPETING INTERESTS

Authors have declared that no competing interests exist.

REFERENCES

1. Bottero JY, Cases JM, Fiessinger F, Poirier JE. Studies of hydrolyse aluminium chloride solutions. 1. Nature of aluminium species and composition of aqueous solutions. Journal of Physical Chemistry. 1980;84:2933-2939.

2. Hill RJ, Hill M. An exposure assessment of the health hazards associated with the intake of aluminium. Part II of a report on the effects of aluminium on human health; 1989.
3. Rondeau V, Commenges D, Jacqmin-Gadda H, Dartigues JF. Relationship between aluminum and silica concentrations in drinking water and Alzheimer's disease: An 8-year follow-up study. *Am J Epidemiol.* 2000;152:59-66.
4. Rondeau V, Commenges D. The epidemiology of aluminium and Alzheimer's disease, in aluminum and Alzheimer's disease, the Science that Describes the Link, C. Exley, (Editor). Elsevier Science B. V; 2001.
5. Rondeau V, Iron A, Letenneur L, Commenges D, Duchene F, Arveiler B, Dartigues JF. Analysis of the effect of aluminum in drinking water and transferring C2 allele on Alzheimer's disease. *Eur J Neurology.* 2006;13:1022-1025.
6. Sollars CJ, Bragg S, Simpson AM, Perry R. Aluminum in European drinking water. *Environ. Technol. Lett.* 1989;10:131-150.
7. Meghzili B, Boussaa M, Medjram MS. Aluminium résiduel et optimisation des étapes de la clarification dans les stations de traitement des eaux. *Science Lib Editions Mersenne.* 2012;4:120118.
8. American Water Works Association Research Foundation. Aluminum in drinking water and Alzheimer's disease: A resource guide. AWWA Research Foundation and the American Water Works Association. 1993;115.
9. Costello JJ. Postprecipitation in distribution systems. *J. Am. Water Works Assoc.* 1984;76:46-49
10. Letterman RD, Driscoll CT. Survey of residual aluminium in filtered water. *J. Am. Water Works Assoc.* 1988;80:154-158.
11. Baes CF, Mesmer RE. The hydrolysis of cations. Wiley, New York. 1976;496.
12. Martell AE. et Motekaitis R. Coordination chemistry and speciation of Al (III) in aqueous solution. Dans: Environmental chemistry and toxicology of aluminum. Lewis TE (dir. de publ.). Lewis Publishers, Chelsea, MI. 1989;3-17.
13. Jean Pierre Jolivet, Marc Henry. De la solution à l'oxyde. Condensation des cations en solution aqueuse. *Savoirs Actuels. interEdition/CNRSEdition;* 1994.
14. Bertsch PM, ET D, Parker R. Aqueous polynuclear aluminum species. In: Esposito G, (éd.). The environmental chemistry of aluminum, 2e éd., CRC Press, Boca Raton (Fla.). 1986;117-168.
15. Parker DR, Bertsch PM. Identification and quantification of the «Al13» tridecameric polycation using ferron. *Environ. Sci. Technol.* 1992a;26:908-914.
16. Parker DR, PM. Bertsch. Formation of the «Al13» tridecameric polycation under diverse synthesis conditions. *Environ. Sci. Technol.* 1992b;26:914-921.
17. Jones KC, Benott BG. Exposure of man to environmental aluminum- exposure commitment assessments. *Total Environ.* 1986;52:65-82.

© 2016 Meghzili et al.; This is an Open Access article distributed under the terms of the Creative Commons Attribution License (<http://creativecommons.org/licenses/by/4.0>), which permits unrestricted use, distribution, and reproduction in any medium, provided the original work is properly cited.

Peer-review history:

*The peer review history for this paper can be accessed here:
<http://sciencedomain.org/review-history/13601>*